

# M<sup>c</sup>CLEARY

## OIL COMPANY INC

1266 N Franklin St  
Chambersburg PA 17201  
717-264-6181  
[www.mcclearyoil.com](http://www.mcclearyoil.com)



New Propane Customers

Thank you for the opportunity to be your propane supplier.

Below is a list that will help insure uninterrupted delivery for your propane.

**SUPPLEMENTAL HEAT USE.** For supplemental heat and will call customers, please call in to receive a delivery when the gauge reads 20% remaining. If a tank runs out, it is a code requirement, as well as a good safety practice that a pressure check be performed which requires that someone is home to allow us in to perform the check. Out-of-gas calls for a single appliance is \$59.00, and for multiple appliances is \$69.00.

**The delivery slip will also be your invoice and you may pay from it. Terms for propane are net due within 10 days of delivery. Monthly statements are mailed for past due balances only.**

### Tank Lease

Minimum usage If minimum gallonage is delivered annually, there is no tank fee.

50 gallon tanks Minimum usage 75 gallons/ year. Annual fee for less than 75 gallons \$50.00

100 gallon tanks Minimum usage 150 gallons/ year. Annual fee for less than 150 gallons \$50.00

Tanks removed at customers' request prior to the 1<sup>st</sup> year anniversary will not receive credit for any remaining propane.

The price of propane is based on your annual consumption. The price is based on a set range of gallons. The retail price of propane can fluctuate throughout the year, and the billing price will be the prevailing price on the day of delivery.

New installations will be billed at the price of propane on the day of installation.

There is an initial TANK INSTALLATION charge of \$85.00. This charge includes setting a tank, hooking up to a previously existing line, leak-checking the complete system. Line installation or additional work can be done at an additional cost.

**Ground settling-Since the condition of the ground is unpredictable, if a tank becomes out of level due to ground conditions, we will return to relevel. A service charge is applicable.**

**TANK IS NOT TO BE MOVED/DISCONNECTED BY ANYONE OTHER THAN McCLEARY OIL COMPANY.**

Initial: \_\_\_\_\_

We greatly appreciate your business.

Customer signature \_\_\_\_\_ Date \_\_\_\_\_

**"Our Family Serving Your Family"  
Since 1928**

# M<sup>c</sup>CLEARY

## OIL COMPANY INC


1266 N Franklin St  
Chambersburg PA 17201

717-264-6181

[www.mcclareyoil.com](http://www.mcclareyoil.com)



### Aboveground ASME Tanks - Spacing

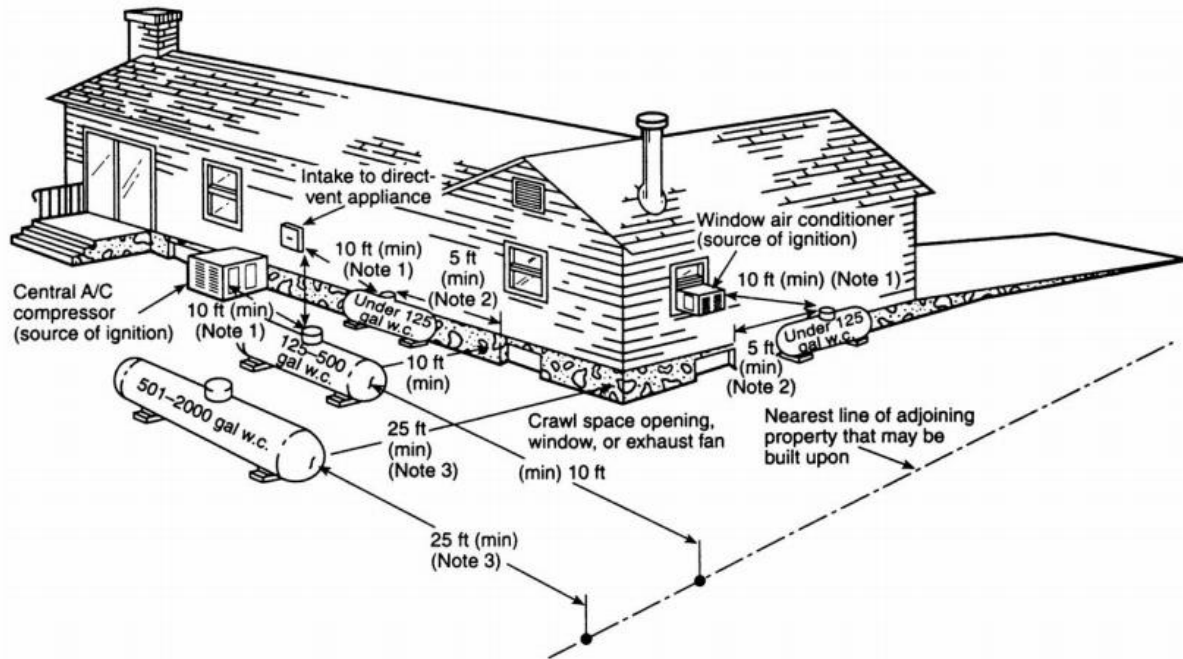

**Notes:**

- 1: Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliances, or intake to a mechanical ventilation system. Refer to 6.3.9.
- 2: Refer to 6.3.9.
- 3: This distance may be reduced to no less than 10 ft for a single container of 1200 gallon water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gallons water capacity. Refer to 6.3.3.

### NFPA 58, 2004 Edition, Annex I, Figure I.1(b) Aboveground ASME Containers

(This figure for illustrative purposes only; local approved codes, regulations and the Authority Having Jurisdiction shall govern)

**"Our Family Serving Your Family"**  
Since 1928